

RAINWATER TANK EXCAVATION/INSTALLATION INSTRUCTIONS


Non-Trafficable 15,000L Rainwater Tank

Non-Trafficable Lid - Maximum Load 300kg Only

Tank + Lid Total Mass = 9.1 Tonnes

Not Suitable for Underground Installation

Partially Buried OK

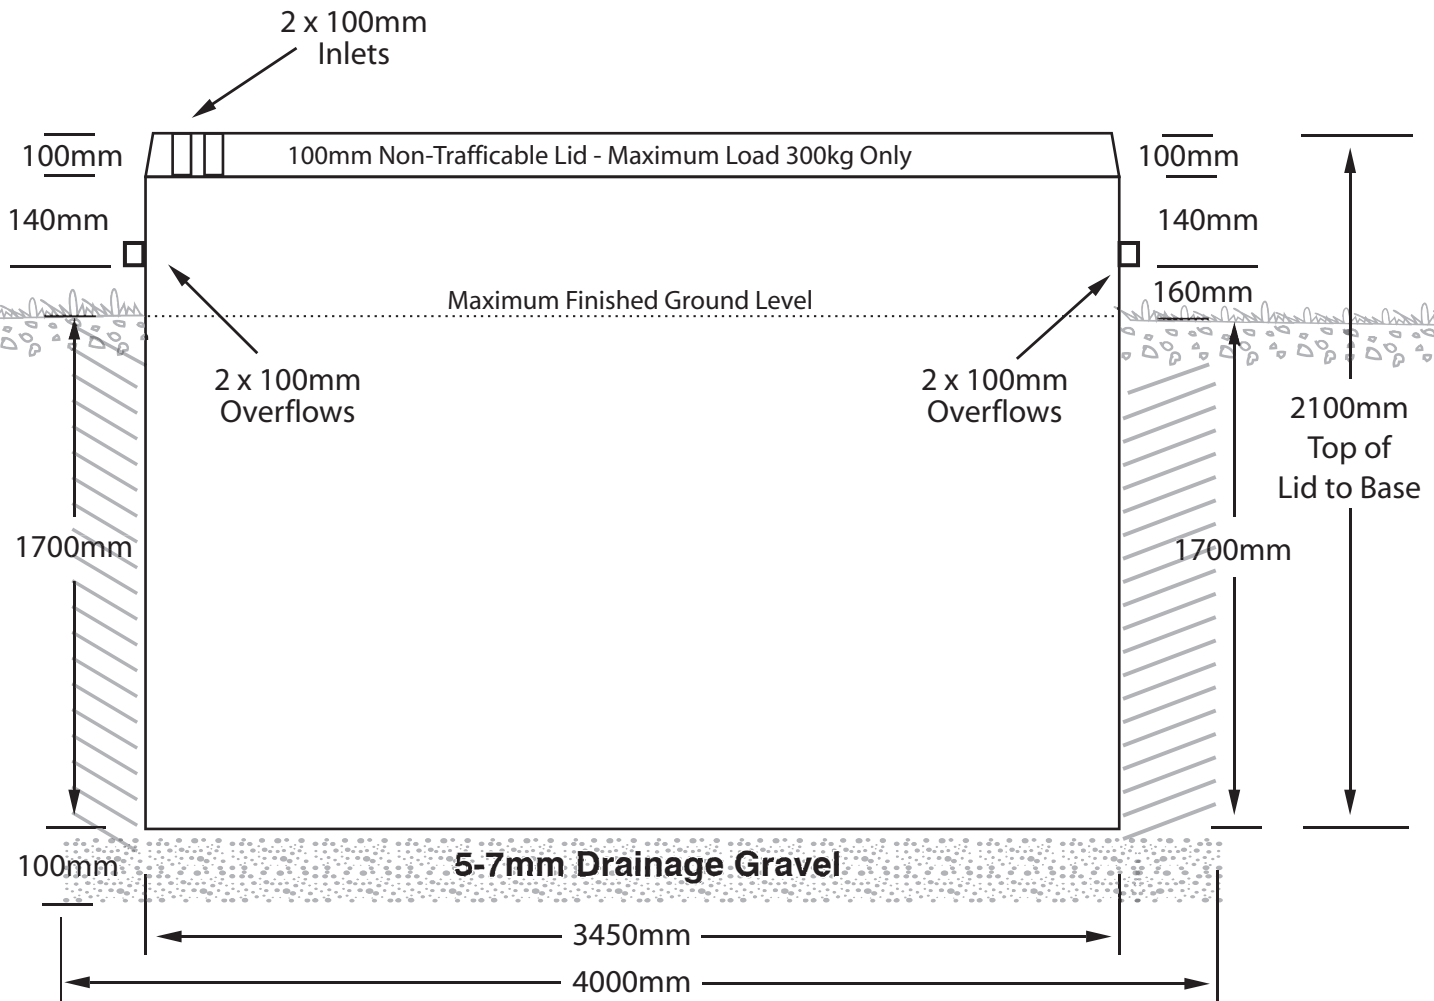

DO NOT USE SAND FOR BASE - WILL VOID WARRANTY

Tanks must be installed perfectly level. Failure to do so will void warranty.

EXCAVATION INSTRUCTIONS

1. Dig hole 4000m Square
2. Depth of Hole 1800mm
3. Cover Base of Hole with 100mm of 5-7mm Drainage Gravel ensuring finished base is perfectly level
Do not have rocks in the base area. It will void warranty.
4. Back Fill with Sand/Soil NOT ROCKS
5. To prevent flotation, fill tank to at least 70% (10,500Lt). Failure to fill tank may cause your tank to float!
Taylex takes NO RESPONSIBILITY for floating tanks. If tank floats, it is up to the installer to rectify and pay for any costs that may be incurred.